



Government of India
Central Electricity Authority

Regional Inspectorial Organisation (South)
Block IV, Floor III, Shastri Bhawan, Chennai – 600 006



Telefax:
044-28257051

Phone:
044-28276579

e-mail:
riosouthceachennai@gmail.com

No. 78/P-569/1/2017-RIO(S)/ 1100

Dated: 07.02.2017

To

The Authorised Signatory
M/s GKM Arcade
No. 2 & 4, 2nd Cross Street
Anna Nagar, Puducherry

Approval for Energizing Electrical Installations
(Under Regulation 43)

Installation:-

Equipment: i) DP structure

ii) LBS – 22 kV, Make: Megawin, Sr. No.: 2016264

iii) Transformer – 315 kVA, 22/0.433 kVA, Megawin, Sr. No.: 1064

iv) Associated, CT, PT, Panels

Location:	GKM Arcade, Puducherry
------------------	------------------------


Inspected by:	Deputy Director, RIO, CEA, Chennai on 19.01.2017
----------------------	--

Reference:-

Your Letter No.	On-line application no. A/2016/01510	Dated	30.11.2016
Our Letter No. (Inspection Report)	78/P-569/1/2017-RIO(S)/1097	Dated	02.02.2017
Your Letter No. (Compliance)	Nil	Dated	04.02.2017

With reference to the above, approval is hereby granted for energizing the electrical installation as given above. This approval is strictly subject to your full compliance with the relevant provisions of the CEA (Measures relating to Safety and Electric Supply) Regulations, 2010 (as amended to date) in every respect. The statement of energisation may please be forwarded to this office immediately after energisation of the installation.

The next inspection of this equipment under regulation 30 shall be due after two years from the date of this approval.


(Gopinadhan Pillai)
Deputy Director
for CEI to Govt. of India

Copy to: - The Chief Engineer (CEI), CEA, New Delhi – 110 066


गोपिनाथन पिल्लै / GOPINADHAN PILLAI
उप निदेशक / Deputy Director
क्षेत्रीय निरीक्षण संगठन
Regional Inspectorial Organisation
केन्द्रीय विद्युत प्राधिकरण
Central Electricity Authority
चेन्नई / Chennai-600 006

8700

AP
Computer

List of Equipment's in M/S. GKM Arcade , No.2 & 4 , 2nd Cross Street , Anna Nagar , Puducherry

- 1) 30feet RCC Pole (Control D.P structure) – 1no (for P.E.D)
- 2) 3c x 95sq.mm(22KV)(E) HT XLPE Al.Cable
- 3) 22KV, 630A, 25KA LBS – 1no (for P.E.D)
Make: Megawin Switchgear – P - Limited
Si.No : 2016264
Current Transformer – 10/5 A , Burden – 15 VA , Acc.Class -0.5 S
Make: Megawin Switchgear – P - Limited
Si.No : 16/3422 , 16/3423 , 16/3424
Voltage Transformer – Burden – 50 VA , Acc.Class -0.5 S
Make: Megawin Switchgear – P - Limited
Si.No: 16/623P, 16/624P, 16/625P
- 4) 315KVA United Sub Station – 1no (for consumer)
(22KV, 630A , 25KA LBS + 315KVA dry cast resin transformer + 630A 4P MCCB)
22KV , 630A , 25KA LBS – 1no
Make: Megawin Switchgear – P - Limited
Si.No : 2015490 (For LBS)
315KVA /22KV / 433 V
Si.No : 1064 (for transformer)
- 5) MSB Panel – 1no
- 6) 125Kvar APFC panel – 1no
- 7) DG Panel – 1no
- 8) Change Over Panel – 2nos
- 9) Fire fighting panel – 1no (common area)
- 10) 8way TPN MCB DB(DD) – 2nos (common area)
- 11) 8way TPN MCB DB(DD) – 3nos (Ground Floor- B)
- 12) Sub – Distribution panel – 2nos (Ground Floor -A – 1no , Ground Floor -B – 1no)
- 13) 8way (V) TPN MCB DB(DD) – 1no (Ground Floor- A)
- 14) 12way SPN MCB DB(DD) – 1no (Ground Floor- A)
- 15) 12way TPN MCB DB(DD) – 1no (Mezzaine Floor -B)

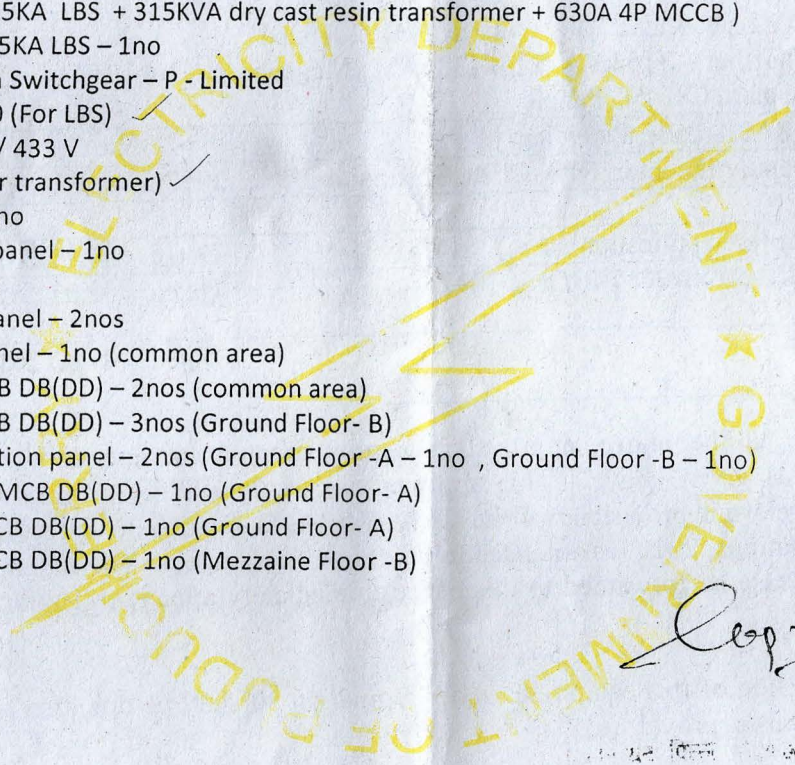

[Handwritten Signature]

ATTN: Mr. MADHAN PILLAI
Secretary Director
Regional Office, Puducherry
Organisation
Puducherry
Priority